


Fair Green

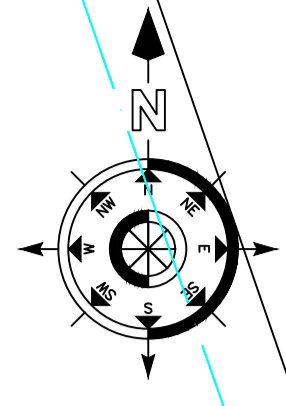

Playground

Private

Public Toilet connection: New 25mm SDR11 PE80 PN12.5 Elbow service pipe to boundary box containing water meter, non return valve and stop cock. Mains connection, service pipe, boundary box and all associated equipment to Irish Water Specification.

G.L. 19.38
I.L. 17.90

Existing M.H.
G.L. 19.10
I.L. 17.90

WATER AND SEWERAGE LAYOUT

IRISH WATER STANDARD DETIALS AND CODE OF PRACTICE

All of the site drainage works should be carried out in accordance with Irish Water's (IW) "Wastewater Infrastructure Standard Details" and "Code of Practice for Wastewater Infrastructure"

For reinforced in-situ items such as manholes etc, allow H12 rebar @ 200c/c both faces. Note that precast options are also specified.

Pipe Materials:

1. Service connections from public toilet to be 100mm Ø unplasticised PVC in accordance with Section 3.13 of the IW Code of Practice.
2. Site sewers to be Thermoplastic structured wall pipes in accordance with Section 3.13 of the IW Code of Practice.


Testing:

1. Site sewers and manholes and Armsstrong Junctions to be tested in accordance with Section 4.10 of IW Code of Practice.
2. CCTV and manhole condition surveys to be carried out in accordance with Section 1.9 of IW Code of Practice in advance of the defects liability period.

Note: All Manhole cover levels to be checked on site to ensure that they are level with the surrounding finished surfaces.

LEGEND :

- Existing Sewer —
- Existing Sewer Manholes ○ M.H.
- Existing Surface Water Pipe —
- Existing Surface Water M.H's ○ M.H.
- Existing Water Main —
- Existing Hydrant ■ H
- New Sewer shown - - -
- New Sewer M.H's □ A.J.
- New Surface Water Pipe - - -
- New Surface Water M.H's □ A.J.
- New Water Service Water Pipe —
- Boundary Box ■ B.B.
- Stop Cock ● S.C.
- Legal Boundary —

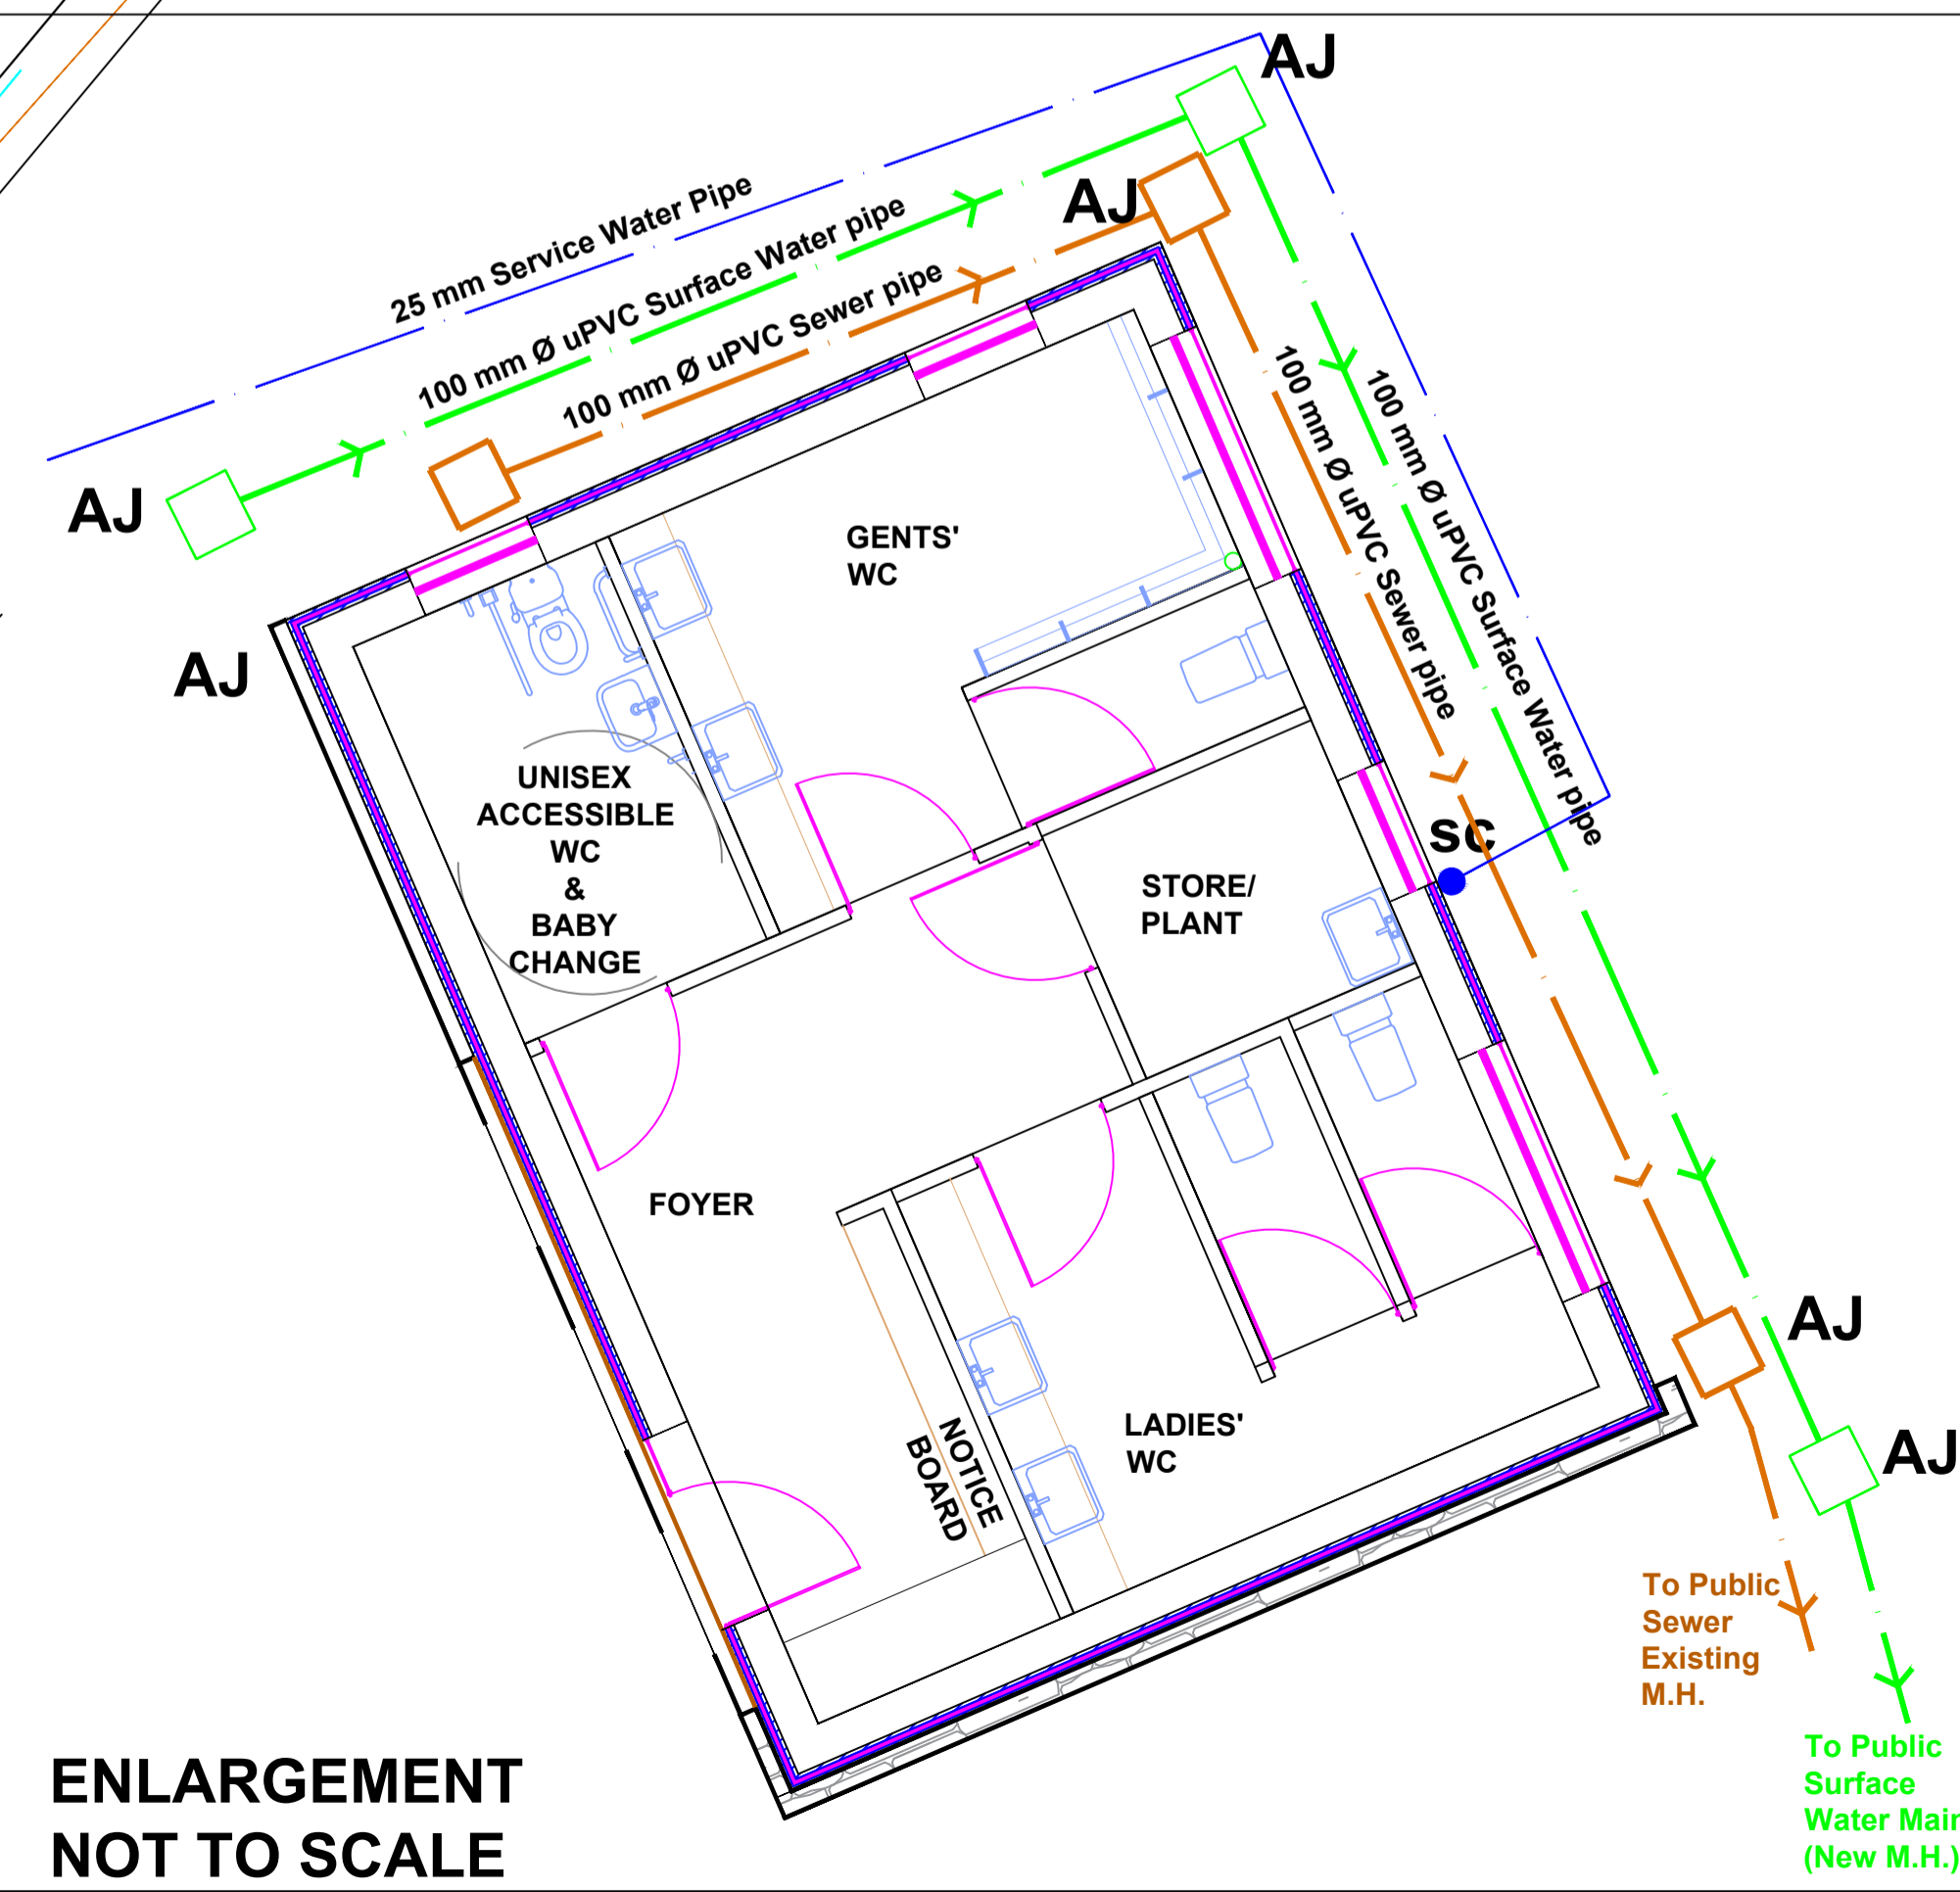

**ENLARGEMENT
NOT TO SCALE**

1	Issued for PLANNING	26-06-2018
No	Drawing Status	Date:
PLANNING - Part 8		

KERRY COUNTY COUNCIL
Capital Infrastructure Unit

TRALEE MUNICIPAL OFFICES
PRINCE'S QUAY
TRALEE

TEL: 066 91300
FAX: 066 7124620
E-MAIL:

Title:
Proposed Public Toilets
At: Fair Green, Ardferf Village, Ardferf
Water and Sewerage Layout Plans

Tom Sheehy B.E. Unit Leader	Designed By :G.L.....
Checked..... Date	Drawn By :J.Carey..
Carolin Liston Executive Architect	Scale:.....1:200 @ A1
Housing Co-Ordinator	Date:.....24-04-2018
Checked..... Date	

Drawing No. H / 18 / 03 - 04