

Workmanship Standards Document No.: ZACC0748000029
 Status: Current Revision: 01
 Owner: 250001 Spillane
 Title: Footway Chambers (Blockwork) No. 2


SECTION A-A
SECTION B-B

PLAN

FOOTWAY CHAMBER No 2 (CONCRETE BOX No. 2)
 ALL MEASUREMENTS IN MILLIMETRES

Ref. H.Q. Drawing Office U6 769 UP DATED: AS AT MAY 2018


- NOTES:**
- THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS & SPECIFICATIONS.
 - THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL THE NECESSARY INFORMATION TO ALLOW THE MAIN CONTRACTOR TO CO-ORDINATE ALL SERVICES.
 - THE CONTRACTOR SHALL CO-ORDINATE FINAL POSITIONS OF ALL EQUIPMENT & SERVICES WITH ALL OTHER TRADES.
 - EXTRA COSTS INCURRED BY THE CONTRACTOR DUE TO THE CO-ORDINATION EXERCISE NOT BEING CARRIED OUT WILL NOT BE ENTERTAINED BY THE ENGINEER.
 - ALL EXTERNAL EQUIPMENT & SERVICES SHALL BE SUITABLY IP RATED.
 - ELECTRICAL INSTALLATIONS TO COMPLY WITH:
 * E.T.C.I. NATIONAL RULES FOR ELECTRICAL INSTALLATIONS.
 * BS-5849-1, 2003+A2:2008
 * BS EN 12464-2
 * CIBSE LG 6
 - THE FINAL DUCT POSITIONS TO BE COORDINATED BY CONTRACTOR ON SITE. THE CONTRACTOR SHALL PRODUCE FINAL CO-ORDINATED FINAL BUILDERS WORK DRAWINGS.
 - ELECTRICAL INSTALLATIONS TO COMPLY WITH:
 * LATEST BUILDERS SPECIFICATION FOR EIR'S TELECOMMS INFRASTRUCTURE REQUIREMENTS.

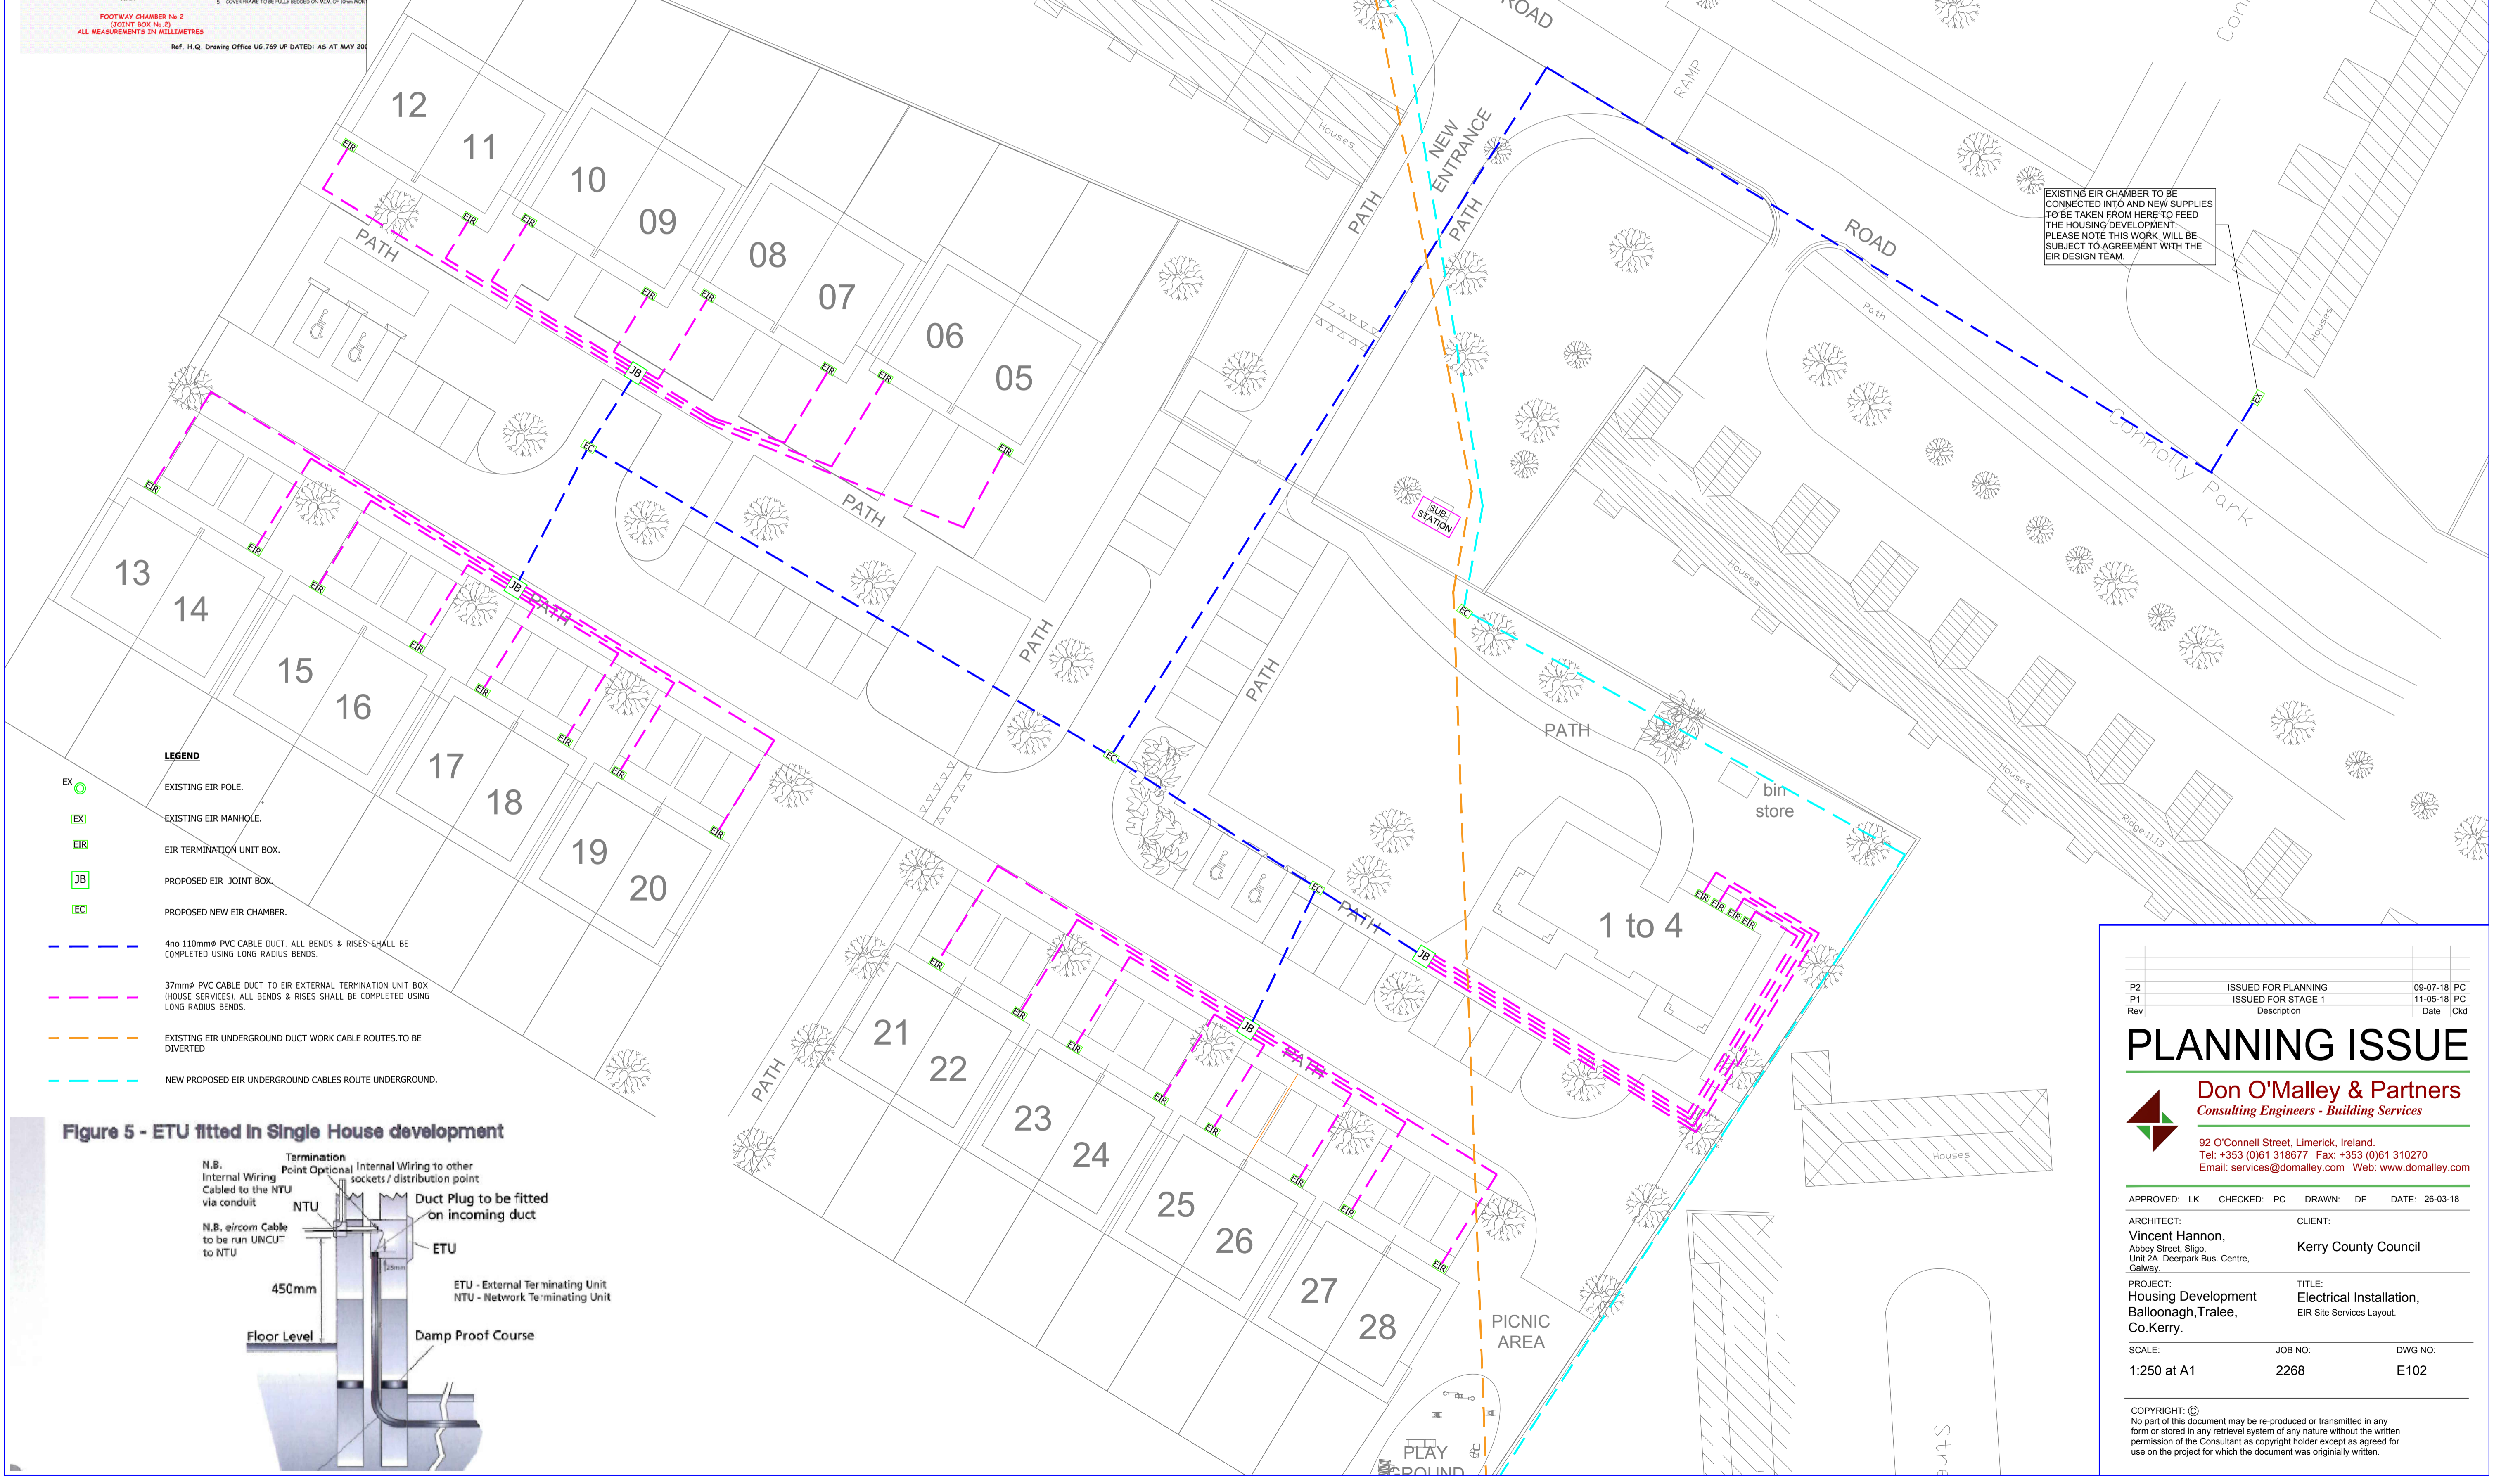

EXISTING EIR CHAMBER TO BE CONNECTED INTO AND NEW SUPPLIES TO BE TAKEN FROM HERE TO FEED THE HOUSING DEVELOPMENT. PLEASE NOTE THIS WORK WILL BE SUBJECT TO AGREEMENT WITH THE EIR DESIGN TEAM.

- LEGEND**
- EX ○ EXISTING EIR POLE.
 - EX □ EXISTING EIR MANHOLE.
 - EIR □ EIR TERMINATION UNIT BOX.
 - JB □ PROPOSED EIR JOINT BOX.
 - ECI □ PROPOSED NEW EIR CHAMBER.
 - 4no 110mm² PVC CABLE DUCT. ALL BENDS & RISES SHALL BE COMPLETED USING LONG RADIUS BENDS.
 - 37mm² PVC CABLE DUCT TO EIR EXTERNAL TERMINATION UNIT BOX (HOUSE SERVICES). ALL BENDS & RISES SHALL BE COMPLETED USING LONG RADIUS BENDS.
 - EXISTING EIR UNDERGROUND DUCT WORK CABLE ROUTES TO BE DIVERTED
 - NEW PROPOSED EIR UNDERGROUND CABLES ROUTE UNDERGROUND.

Figure 5 - ETU fitted In Single House development

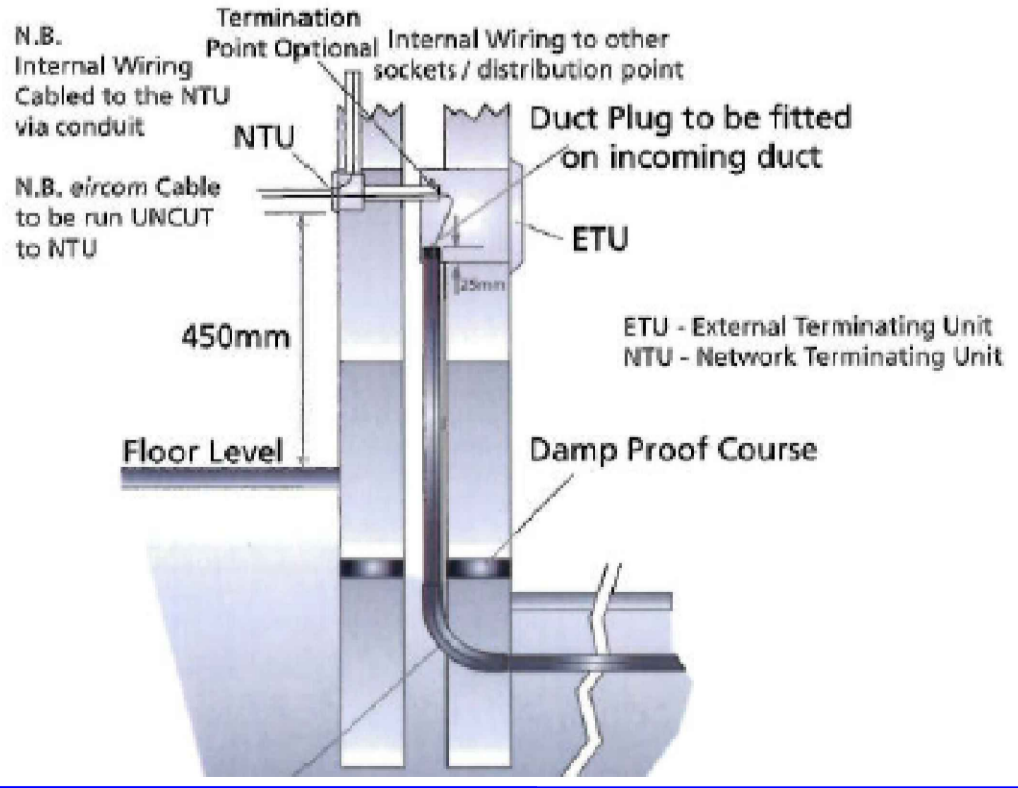

P2	ISSUED FOR PLANNING	09-07-18	PC
P1	ISSUED FOR STAGE 1	11-05-18	PC
Rev	Description	Date	Ckd

PLANNING ISSUE

Don O'Malley & Partners
 Consulting Engineers - Building Services

92 O'Connell Street, Limerick, Ireland.
 Tel: +353 (0)61 318677 Fax: +353 (0)61 310270
 Email: services@domalley.com Web: www.domalley.com

APPROVED: LK CHECKED: PC DRAWN: DF DATE: 26-03-18

ARCHITECT: Vincent Hannon, Abbey Street, Sligo, Unit 2A Deepark Bus Centre, Galway. CLIENT: Kerry County Council

PROJECT: Housing Development, Ballymogh, Tralee, Co. Kerry. TITLE: Electrical Installation, EIR Site Services Layout.

SCALE: 1:250 at A1 JOB NO: 2268 DWG NO: E102

COPYRIGHT: ©
 No part of this document may be re-produced or transmitted in any form or stored in any retrieval system of any nature without the written permission of the Consultant as copyright holder except as agreed for use on the project for which the document was originally written.